





**Hidro
Pnevmo
Tehnika**

3, Vojeli St., Kazanlak, Bulgaria
Tel.: +359 431/ 62 228, 68 440
e-mail : info@hpt-bg.com
www.hpt-bg.com



FLOW CONTROL VALVE

RD2 - .. N

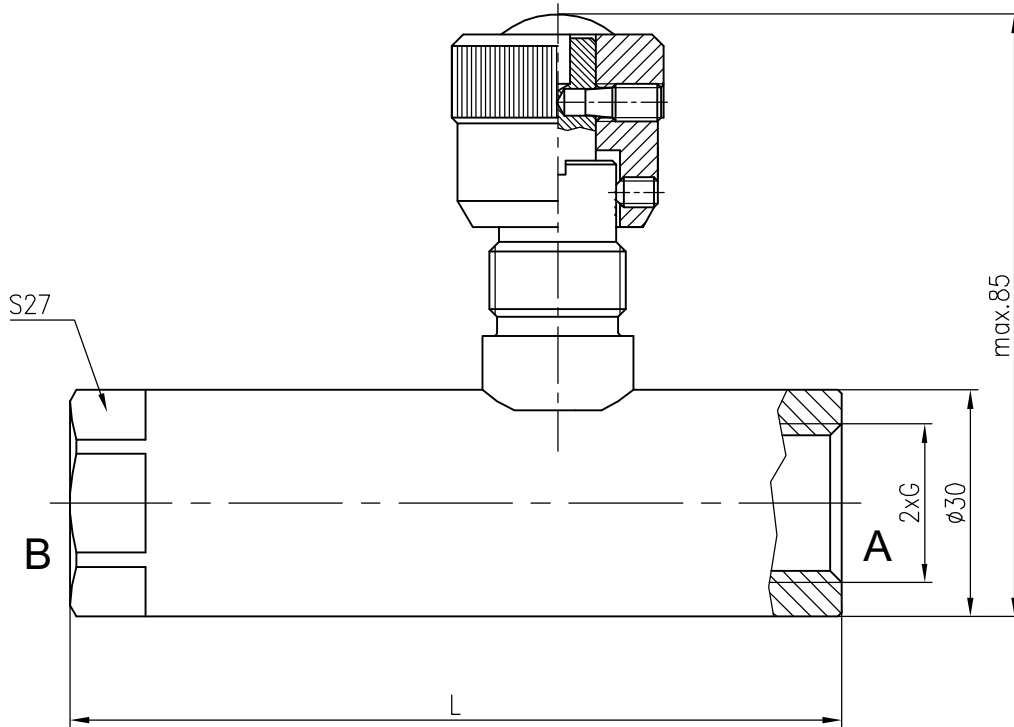

Type	Q_{max}	$Q_{min.}$	$P_{max.}$	L	G
	L/min	L/min			
RD2-25N	25	2	200	92	G3/ 8"
RD2-40N	40	3		102	G1/ 2"

All performances and calibration are carried out by using hydraulic oil with viscosity approx. 46 cSt at 50 °C .
Temperature range: -20 °C...+80 °C.
Filtration absolute: 25 µm

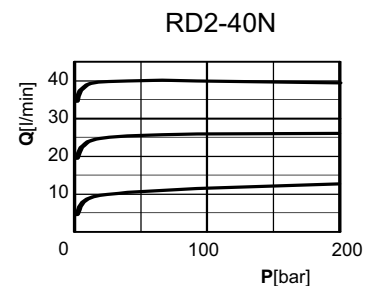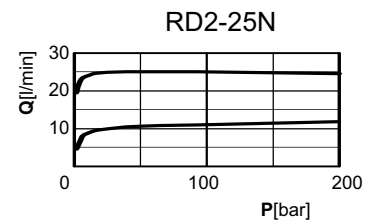

ORDERING CODE

